

Power Poles

Technical Guide D15.9

Strong, durable prestressed concrete Octagonal and I Section profile Power Poles. For use in New Zealand's electricity power supply networks.



12.24 | DRAINAGE | D15.9 POWER POLES

Applications

Electrical Transmission lines

Urban and Rural sites

Product Attributes

Strong and durable Octagonal and I Section power poles.

For use in New Zealand's electricity power supply networks

Will Not rot

High quality concrete finish

Approvals/Standards

AS/NZS 4065:2010

Transpower TP.PL 01.15 for Octagonal Poles

Quality

ISO 9001:2015 Quality Management System

ISO 4500 1:2018 Health and Safety

We are the supply partner of choice for New Zealand's civil construction industry, specialising in water and infrastructure based solutions.

HYNDS
PIPE SYSTEMS

General details of Poles.

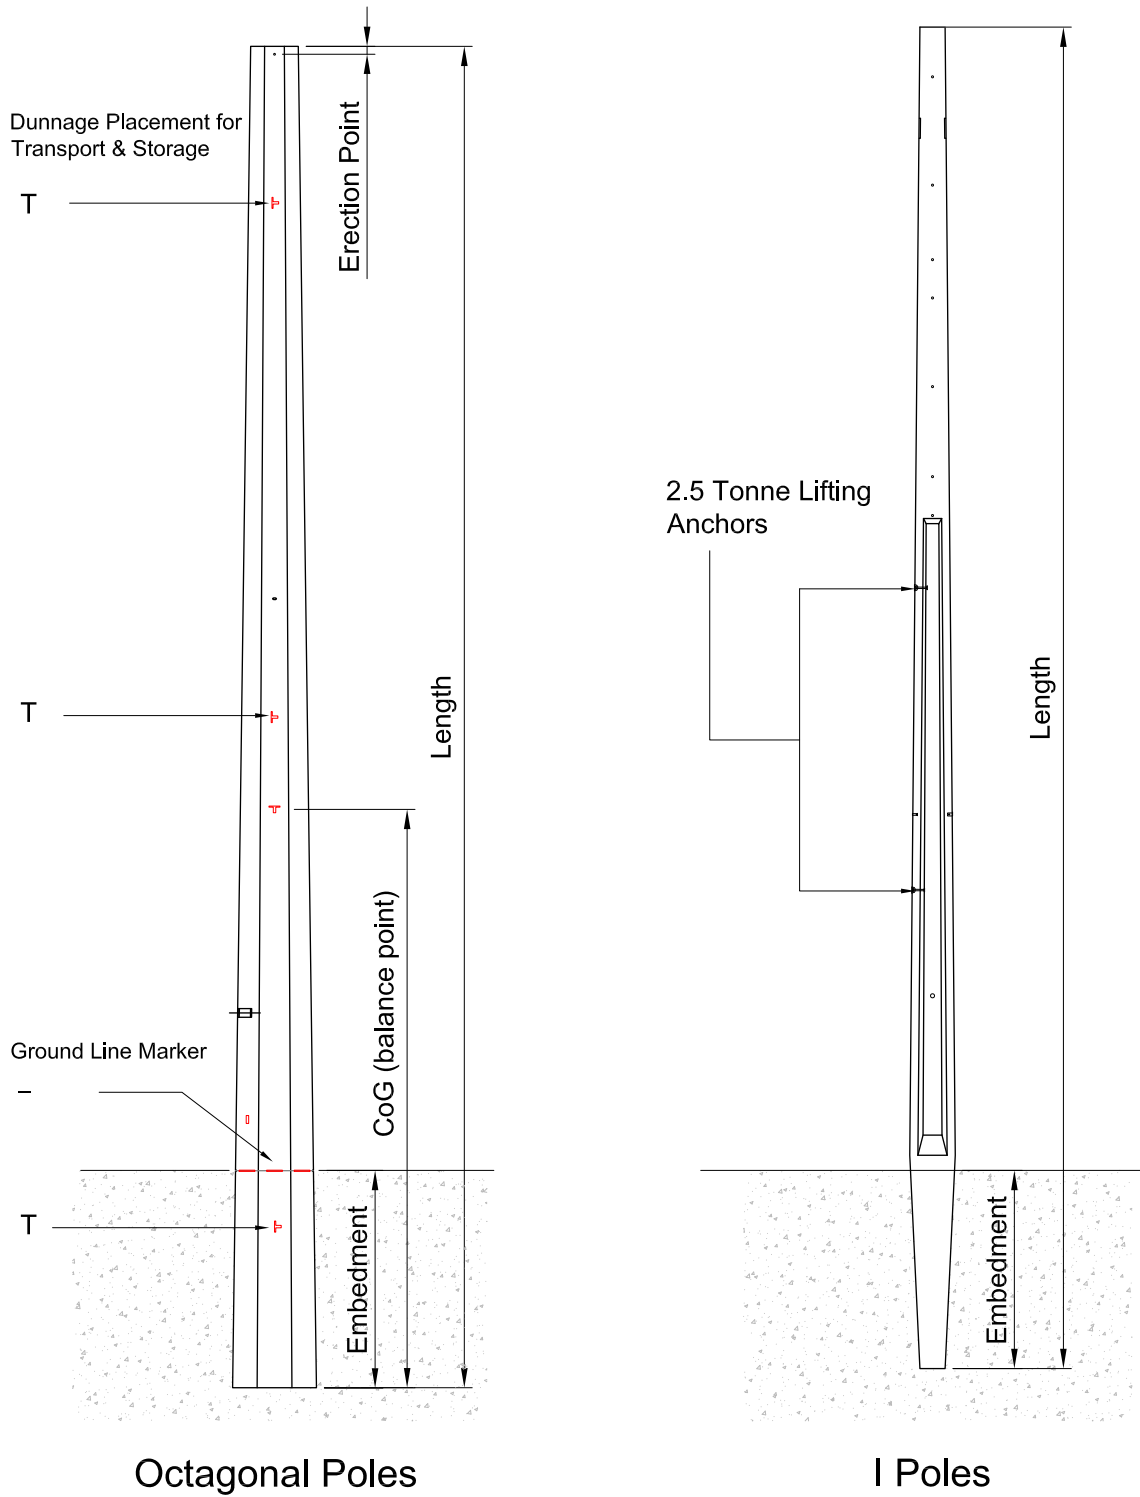


FIG. 1

TABLE 1 | Poles

Code	Length (m)		Weight (tonne)	Lifting Anchor 2 per Pole	Design (kN) ultimate	
	Overall	Embedment			Transverse	Downline
MP11X	11	2	1.7	2.5 tonne	20	10
MP14	14	2.5	3.0	2.5 tonne	20	10

TABLE 2 Octagonal Poles

Code	Length (m)		Weight (tonne)	Lifting Anchor from Base(m)	Design (kN) ultimate	
	Overall	Embedment			Guyed	Unguyed
Normal Strength						
OP155S	15.5	2.5	1.4	6.74	18	12
OP17S	17.0	2.8	3.0	7.33	18	12
OP185S	18.5	3.0	4.1	8.02	24	16
OP20S	20.0	3.2	4.4	8.63	24	16
OP215S	21.5	3.4	6.0	9.22	36	24
OP23S	23.0	3.6	6.5	9.79	36	24
High Strength						
OP155HS	15.5	2.5	4.2	6.74	36	24
OP17HS	17.0	2.8	4.8	7.33	36	24
OP185HS	18.5	3.0	5.0	8.02	36	24
OP23HS	23.0	3.6	10.8	9.47	48	32



FIG. 2 | Section power pole



FIG. 3 | Octagonal power pole

Handling

I Poles are lifted using 2.5 tonne Switflift anchors, Octagonal Poles are lifted using Strops about the balance point.

When erecting and for vertical alignment of Octagonal Poles, use the Erection Point which is a hole 100mm down from the tip of the Pole.

Hynds Power Poles are fitted with a Label Plate (Fig 4) which indicates Design loadings, Pole length and weight to ensure correct lifting equipment has been selected for handling.

If units are stored on site, they will need to be placed on dunnage sitting on firm level ground.

I Poles dunnage should be placed 1/5 x the length of the Pole from each end.

Octagonal Poles have dunnage placement points marked as per Fig 5

Hynds recommend single stacking of Power Poles only, if double stacking is needed ensure dunnage is aligned vertically so as not to induce large point loads.



FIG. 4



FIG. 5

Branches Nationwide Support Office & Technical Services 0800 93 7473

Disclaimer: While every effort has been made to ensure that the information in this document is correct and accurate, users of Hynds product or information within this document must make their own assessment of suitability for their particular application. Product dimensions are nominal only, and should be verified if critical to a particular installation. No warranty is either expressed, implied, or statutory made by Hynds unless expressly stated in any sale and purchase agreement entered into between Hynds and the user.